


**DEHNguard modular** DG MP TN ACI 275 FM, DG MP TT 2P ACI 275 FM


- DE Einbauanleitung
- GB Installation instructions
- IT Istruzioni di montaggio
- FR Instructions de montage
- NL Montagehandleiding
- ES Instrucciones de montaje
- PT Instruções de montagem
- DK Monteringsvejledning
- SE Monteringsanvisning
- FI Asennusohje
- GR Οδηγίες συναρμολόγησης
- PL Instrukcja montażu
- CZ Návod k montáži
- TR Montaj kılavuzu
- RU Инструкция по монтажу
- CN 安装说明
- HU Szerelési útmutató
- JP 設置説明書




II IEC 61643-11...  
2 EN 61643-11...

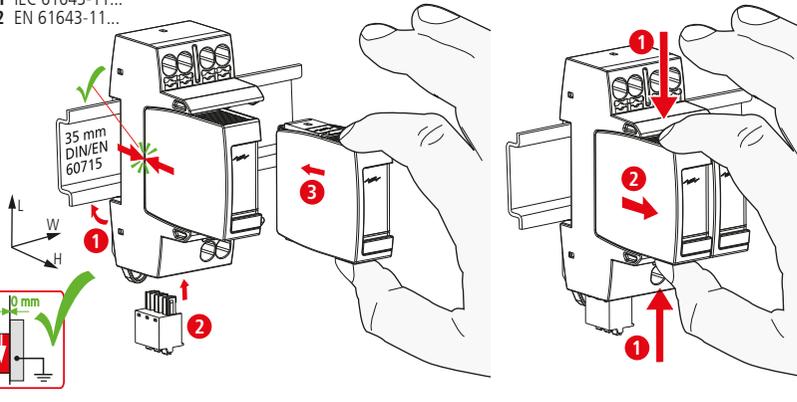

DG MP TN ACI 275 FM





DG MP TT 2P ACI 275 FM





	DG MP TN ACI 275 FM		DG MP TT 2P ACI 275 FM	
	L-PE	N-PE	L-N	N-PE
DG MOD ACI 275	DG MOD A NPE	DG MOD ACI 275	DG MOD A NPE	
$U_N / Tol.: \pm 10\%$	230 / 400 V (50/60 Hz)			
$U_c$	275 V	255V	275 V	255V
$I_{SCCR}$	25 kA <sub>rms</sub>	---	25 kA <sub>rms</sub>	---
$I_{li}$	---	100 A <sub>rms</sub>	---	100 A <sub>rms</sub>
$\theta$	-40°C ... +80°C			
$\varphi$	5% ... 95%			
$I_{be}$	< 5 µA			
IP 1)	20			
L x W x H	90 mm x 36 mm x 77 mm			

	15 mm	15 mm	15 mm	15 mm
$\square$ L, N, PE(N), $\perp$	1.5 - 10 mm <sup>2</sup>	6 - 10 mm <sup>2</sup>	1.5 - 10 mm <sup>2</sup>	1.5 - 6 mm <sup>2</sup>

TN DG MP TN ACI 275 FM

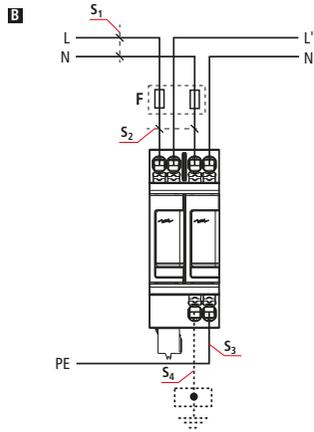
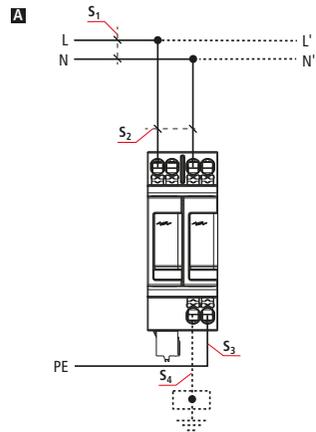


TT DG MP TT 2P ACI 275 FM

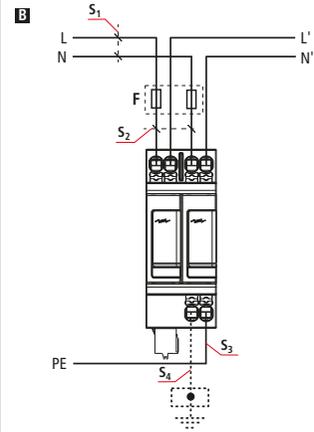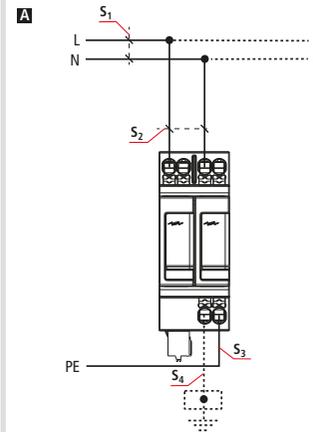

$S_1 / \text{mm}^2$	max. $I_k$	$S_2 / \text{mm}^2$	$S_3 / \text{mm}^2$	$\perp$
$X - X$ <sup>mm<sup>2</sup></sup>	$\leq 25 \text{ kA}$ <sup>3)</sup>	$\geq 6 \text{ mm}^2$ <sup>2)</sup>	$\geq 6 \text{ mm}^2$	<del><math>\perp</math></del>
$\leq 10 \text{ mm}^2$	$\leq 25 \text{ kA}$	$= S_1$	$= S_1$ min. 6 mm <sup>2</sup>	<del><math>\perp</math></del>

$F$ A gG	$S_2 / \text{mm}^2$	$S_3 / \text{mm}^2$	$S_4 / \text{mm}^2$
25	4	6	6
32	6	6	6
40	10	10	10

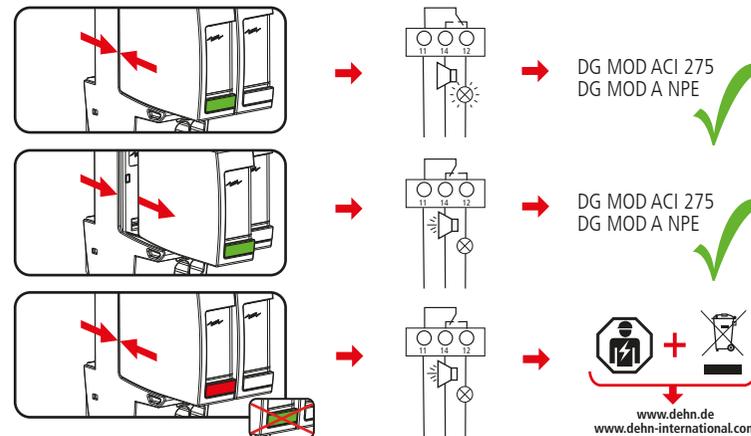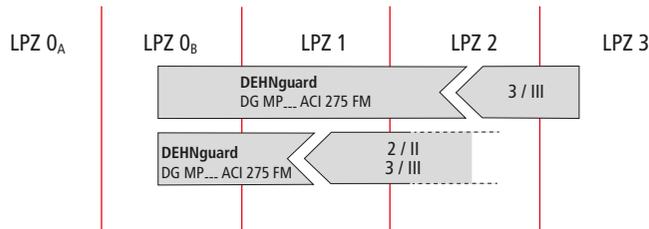

**DEHNguard modular**  
DG MP TN ACI 275 FM, DG MP TT 2P ACI 275 FM

	$U_N / I_N$	AC: 250 V / 0.5 A
		DC: 250 V / 0.1 A 125 V / 0.2 A 75 V / 0.5 A

max. 1.5 mm<sup>2</sup>

