

1. Extension

Expert opinion

No. 20181663

1. Official copy

Customer: Günther Spelsberg GmbH + Co. KG
Im Gewerbepark 1
58579 Schalksmühle
Germany

Product designation: Type „WKE 405 LSA“ fire protection junction box
by Günther Spelsberg GmbH + Co. KG

Remit: Expert opinion on the fire protection characteristics of the junction
boxes „WKE 405LSA“ in respect of guarantee of the functional
integrity of cable systems in the event of fire

Validity extended until 2028-12-18

The first extension of the expert opinion extends expert opinion no. 20181663 dated 2018-12-19.

The first extension of the expert opinion is only valid in connection with expert opinion no. 20181663 dated 2018-12-19 and may only be used together with it.

The expert opinion no. 20181663 also applies with reference to the edition of DIN EN 61439-1:2021-10 (footnotes 1 and 2).

This extension of the expert opinion comprises 1 page of text and 0 appendices.

Freiberg, 2024-07-16


Dr.-Ing. A. Meißner
Test Centre Manager



M. Fischer, B.Sc.
Test Engineer

Note: In case of doubt the German version of the expert opinion no. 20181663 is valid.

The reproduction and publication of extracts from the expert opinion requires the written authorisation of MPA Dresden GmbH in each individual case. The individual pages have been endorsed with the official stamp of the company MPA Dresden GmbH.

Expert opinion

No. 20181663

1st official copy

Customer: Günther Spelsberg GmbH + Co. KG
Im Gewerbepark 1
58579 Schalksmühle


Product designation: Type "WKE 405 LSA" fire protection junction box
by Günther Spelsberg GmbH + Co. KG

Remit: Expert opinion on the fire protection characteristics of the junction
boxes "WKE 405 LSA" in respect of guarantee of the functional
integrity of cable systems in the event of fire

Validity: 2023-12-18

This expert opinion comprises 3 pages of text and 1 appendix.

The publishing of expert opinions, even extracts therefrom, and references to tests for the purposes of advertising requires the written consent of MPA Dresden GmbH in each individual case. The individual pages of this expert opinion have been endorsed with the official stamp of the company MPA Dresden GmbH.

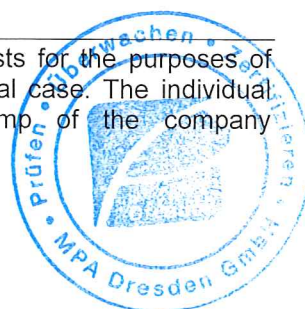

MPA Dresden GmbH
Fuchsmühlenweg 6F
09599 Freiberg
www.mpa-dresden.de

Geschäftsführer: Thomas Hübler
Tel. +49(0)3731-20393-0
Fax +49(0)3731-20393110
E-Mail info@mpa-dresden.de

Amtsgericht Chemnitz HRB 28268
Steuernummer: 220/114/03364
USt-IdNr. DE291271296

Sparkasse Mittelsachsen
Poststraße 1a
09599 Freiberg
IBAN DE68 870520003115024672
BIC WELADED1FGX

1 General

Günther Spelsberg GmbH + Co. KG instructed MPA Dresden GmbH to issue an expert opinion to evaluate the fire protection characteristics of the type WKE 405 LSA junction box in cable systems which guarantee functional integrity for a period of over 30 minutes in the event of fire.

2 Basis for the expert opinion

- [1] Product information "Junction box WKE 405 LSA" by Günther Spelsberg GmbH + Co. KG;
- [2] Test report no. 20180714 by MPA Dresden GmbH dated 2018-09-12;

3 Description of the type WKE 405 LSA junction boxes

The type WKE 405 LSA junction boxes are deployed in cable systems in which multi-core functional integrity cables (max. core diameter of 0.8 mm, JE-H(St)H4x2x0.8) are connected together.

The Duroplast junction box has the following dimensions: length 200 mm x width 200 mm and height 110 mm.

The type WKE 405 LSA junction boxes consist fundamentally of a housing with cover, the ceramic terminal strip, cable entries, retaining /fastening plates and a seal located between housing and cover.

The construction of the WKE 405 LSA junction boxes and the positions of the above listed components are shown in Appendix 1. Further descriptions and details are set out in the MPA Dresden GmbH test report 20180714 dated 2018-09-12 [2].

The junction boxes are mounted on solid walls using building authority approved fasteners.

The incoming /outgoing functional integrity cables (Dätwyler, JE-H(St)H4x2x0.8) are to be fastened to the wall with cable clamps at a distance of max. 100 mm from the junction box.

4 Evaluation

With the fire test [2] on the junction boxes of the type series WKE 405 LSA, which comply with the description in section 3 and Appendix 1, it was verified that the functional integrity of individual, horizontally laid multi-core functional integrity cables which constitute a part of a cable system with functional integrity (minimum duration of functional integrity 30 minutes) also in special operating conditions in accordance with DIN EN 61439-1:2012-06¹, Section 7.2 (in this case firing of the cable system as per the time-temperature curve in accordance with DIN EN 1363-1) over a period of up to 30 minutes was confidently given.

5 Summarised evaluation

If junction boxes of the type series WKE 405 LSA which are constructed as described in section 3 are deployed in electrical cable systems with a verified functional integrity of at least 30 minutes in the event of fire then it can be assumed with a high level of probability that in the event of fire the functional integrity of the cable systems is also further given over a period of at least 30 minutes (special operating conditions in accordance with DIN EN 61439-1:2012-06², Section 7.2).

¹ DIN EN 61439-1:2012-06

Low-voltage switchgear and control gear assemblies - Part 1: General rules (IEC 61439-1:2011); German edition EN 61439-1:2011

² DIN EN 61439-1:2012-06

Low-voltage switchgear and control gear assemblies - Part 1: General rules (IEC 61439-1:2011); German edition EN 61439-1:2011



6 Special notes

The expert opinion no. 20181663 dated 2018-12-19 does not constitute a general building authority verification of usability in the sense of the State Building Code.

The expert opinion no. 20181663 dated 2018-12-19 is valid solely for the building products and installation situation as described in section 3.

The validity of the expert opinion no. 20181663 expires on the **2023-12-18** and can thereafter be extended upon application.

Freiberg, 2018-12-19



Dr.-Ing. A. Meißner
Test Centre Manager, Fire Protection



Dipl.-Ing. G. Wiesner
Test Engineer, Fire Protection

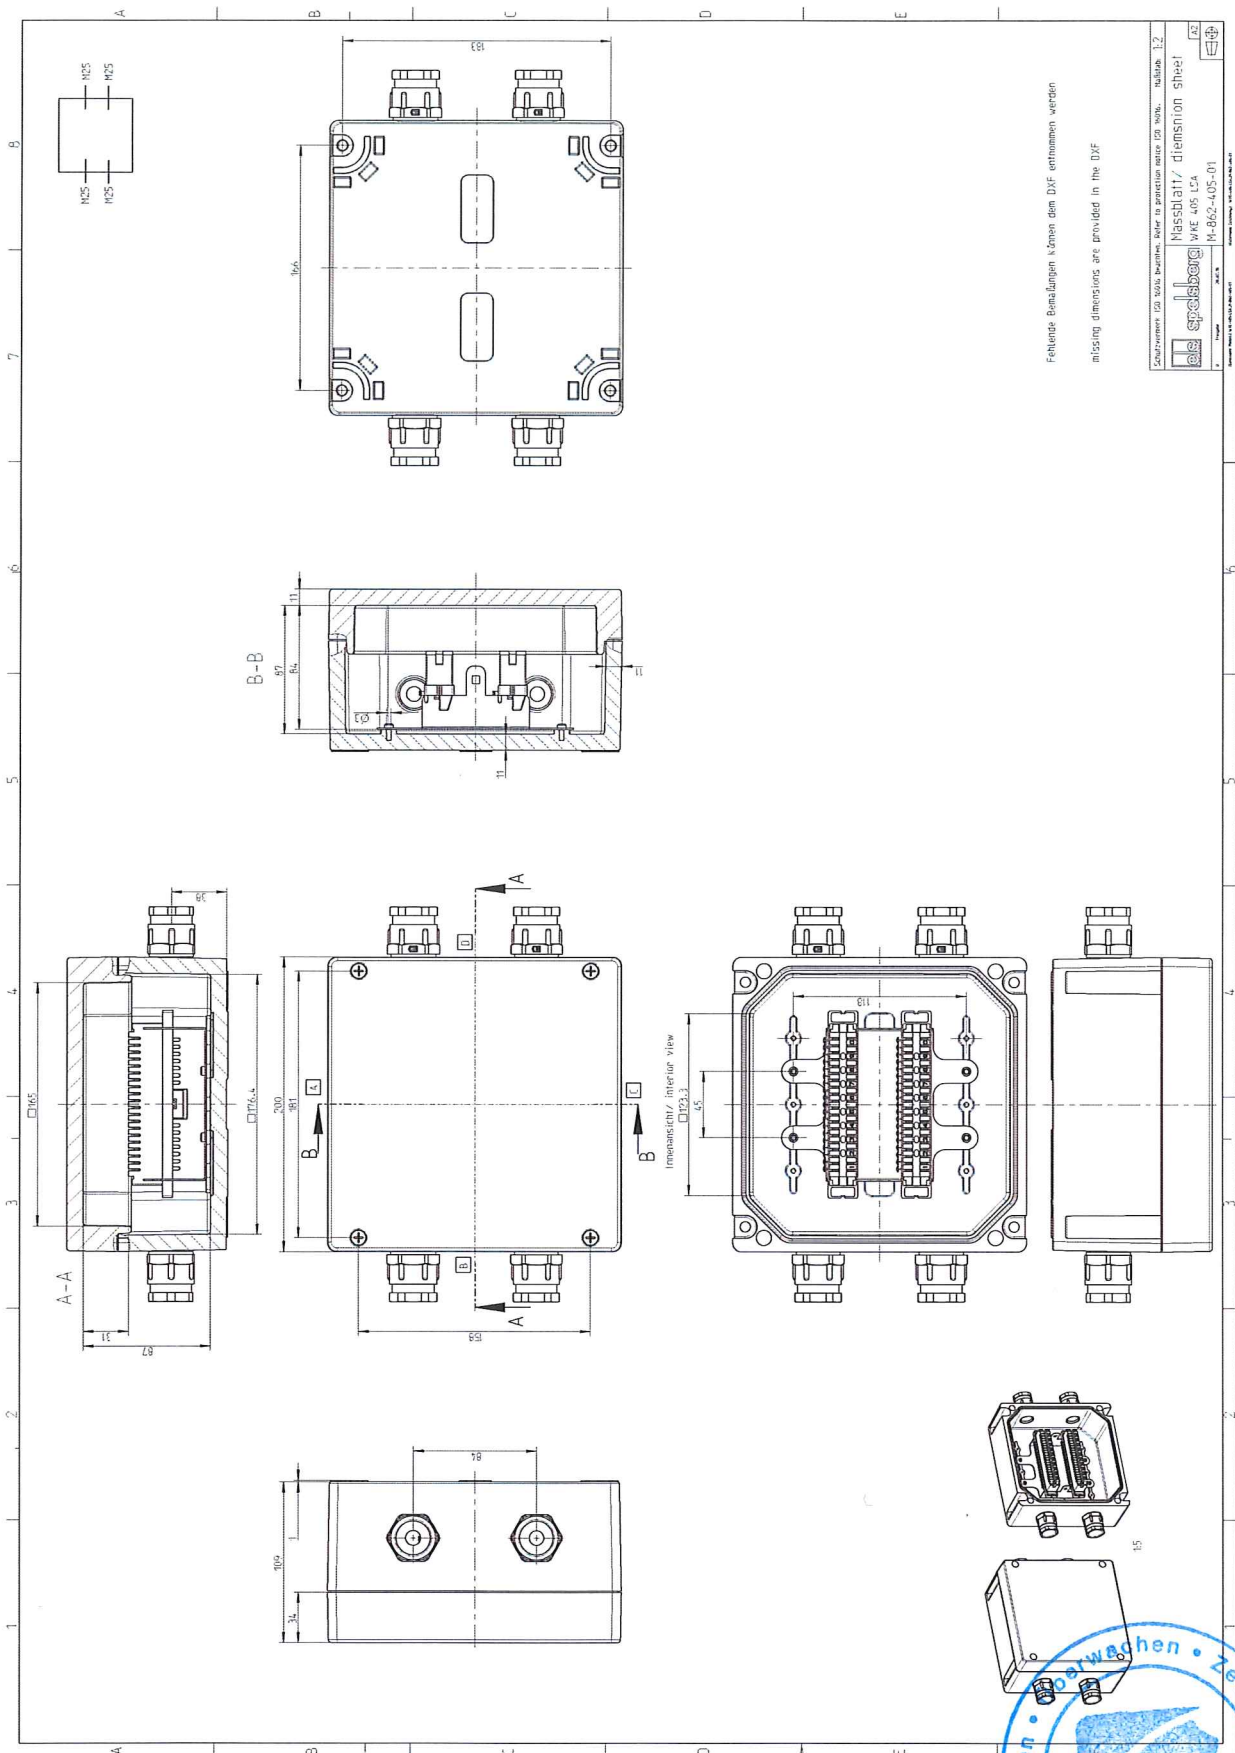


Fig. 1: WKE 405 LSA

