



INSTRUCTION

REGIOLUX

Regiolux GmbH
 Hellinger Str. 3
 D-97486 Königsgberg/Bay.
 T 09525 89-0
<http://www.regiolux.de>
info@regiolux.de




SDT-System

IP20 / 64 / 40

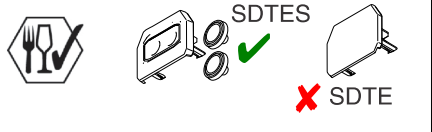

SDT	182
SDCS	1890 0034 101
SDH	1890 0039 100
SDD	1890 0033 100
SDCT	1890 0042 100
SDTAF-7	1820 3092 100
SDTAM-7	1820 3090 100

SDTE	1820 0231 100
SDTES	1820 0235 100
SDTV	1820 0020 100
SDTVL	1820 0031 100
SDTVLS	1820 0050 100
SDBK	1883 7580 101
SDBAS	1882 6580 100
SDBKS	1883 7580 151
SDBA	1883 6580 100

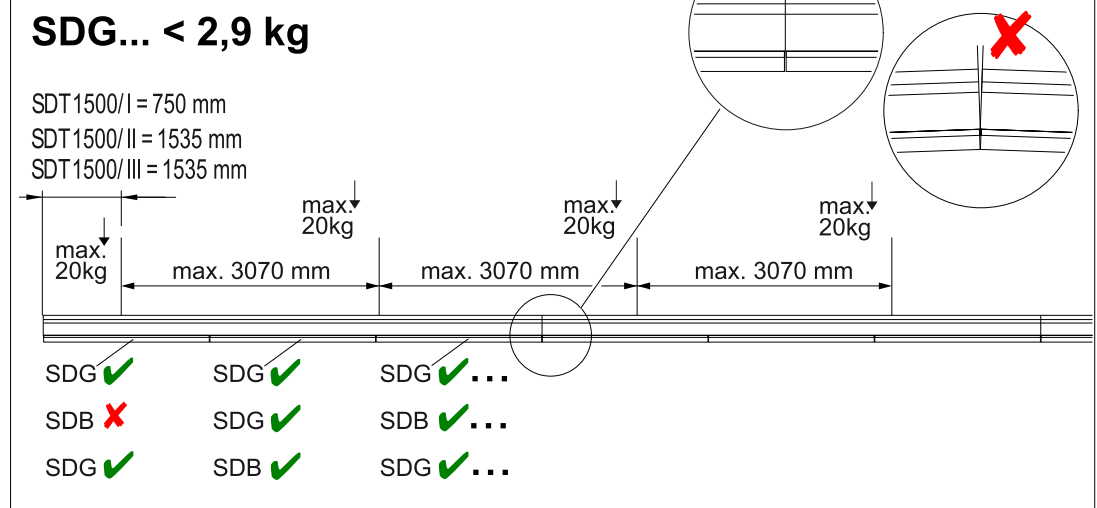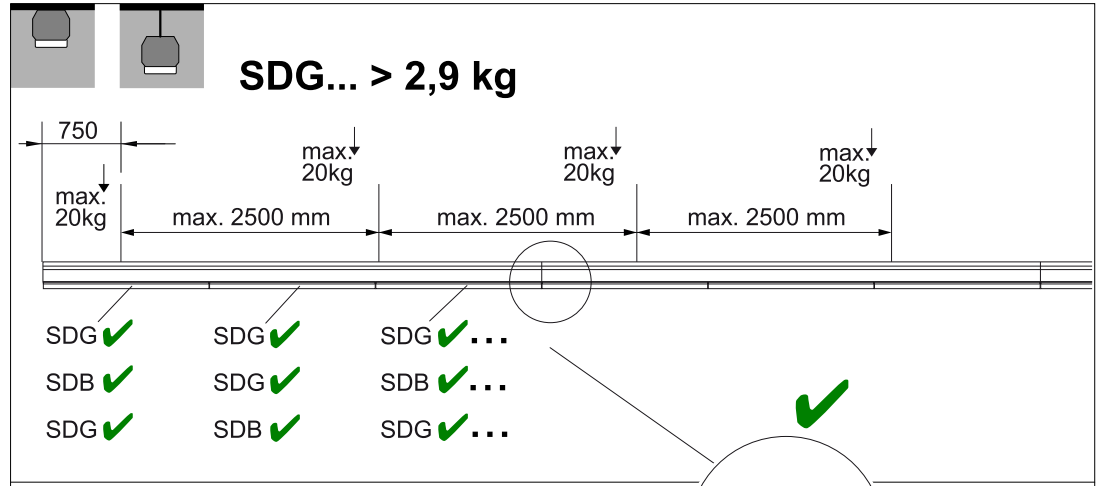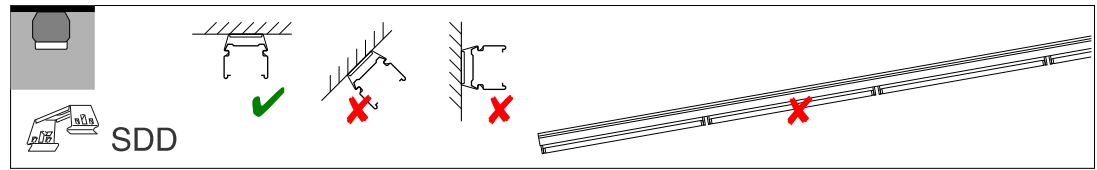

IP20/64/40

SDH | SDD

SDTAF | SDCT

SDCS

IP64

SDTVLS

SDBAS

SDBKS

IP20

SDTE

SDTV

SDTVL

SDBK

SDBA

IP40

SDTES



SDTV








SDTVL

SDBAS

SDBKS

Art.-Nr.: 530491 - 07/2024

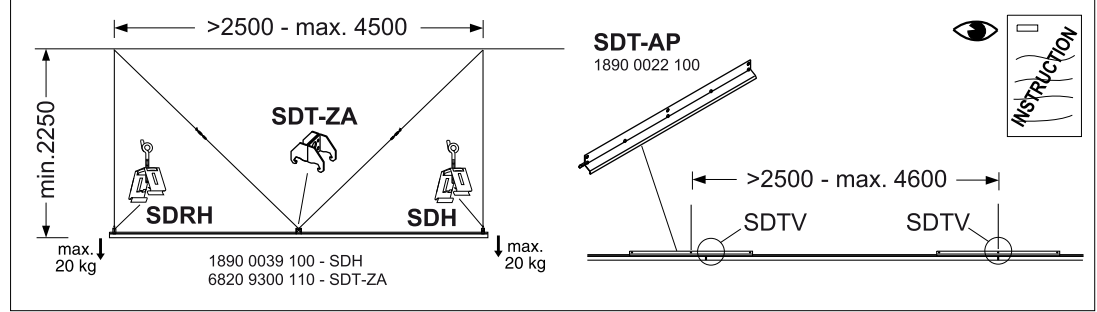

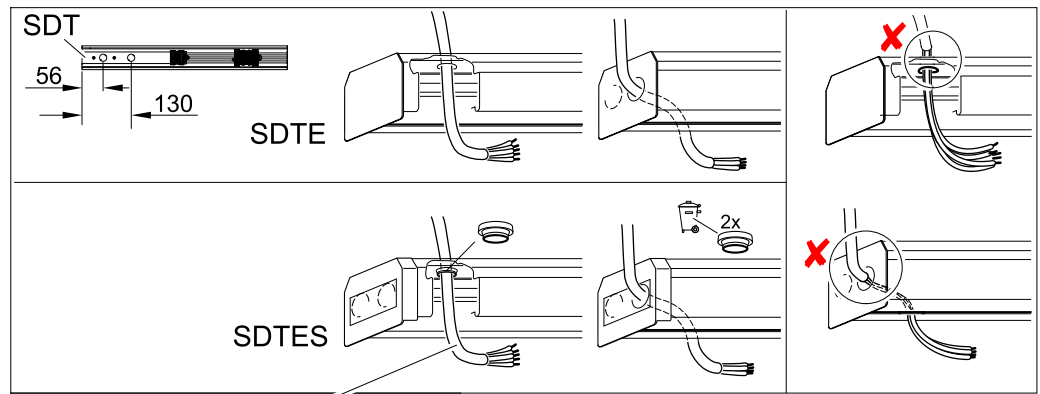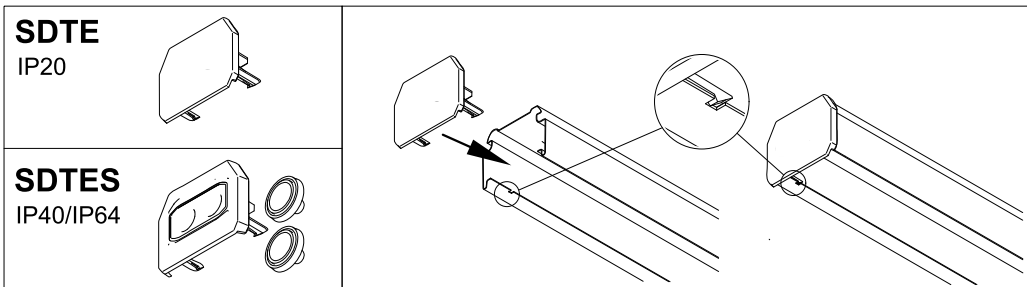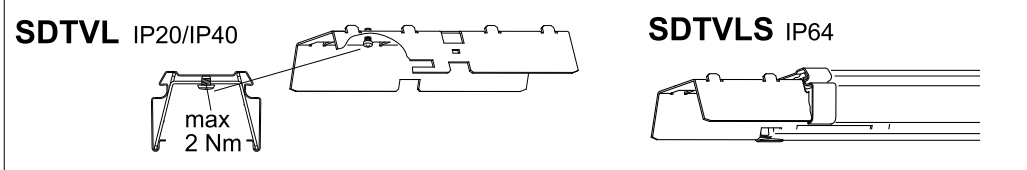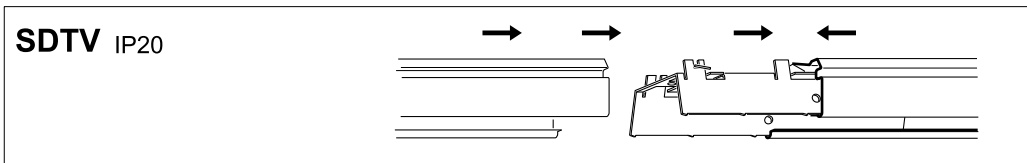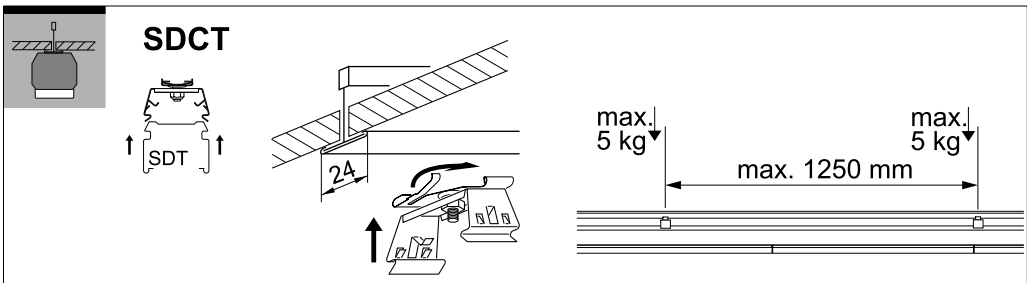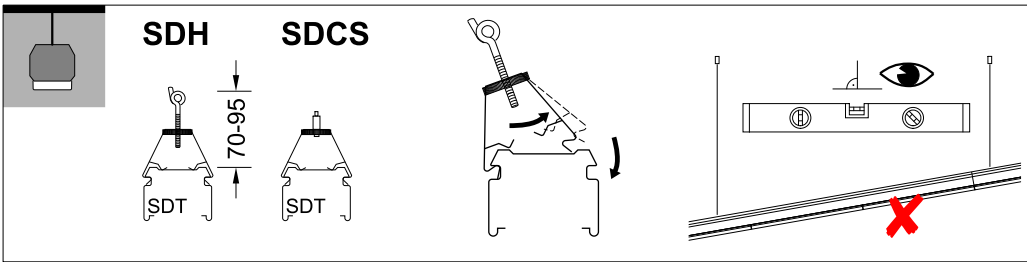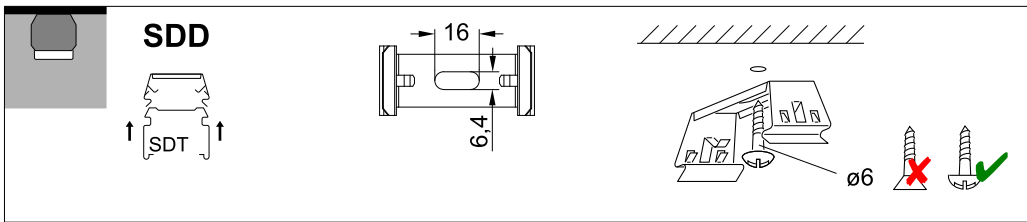

1,5-2,5 mm² "e"
11-12-mm

VDE 0100

Leitung	N	PE	I max.		
			1	2	3
			L1	L2	L3
5 x 1,5mm ²	N		3x max. 16A		
5 x 2,5mm ²	N		3x max. 16A		
7 x 2,5mm ²	N		3x max. 16A		

